


PLAN

- NOTES:**
1. ACCEPTABLE REDUCED PRESSURE ZONE ASSEMBLIES:
WATTS 009M2QT OR M3QT, WATTS 909M1QT, WILKINS 975XL, WILKINS 375, APOLLO (CONBRACO) RP4A, OR APOLLO (CONBRACO) 40-200
 2. RPZ REQUIRED FOR UNDERGROUND SPRINKLERS LOCATED ON THE EXTERIOR OF THE HOME.
 3. SWIMMING POOLS SHALL HAVE A TESTABLE DOUBLE CHECK VALVE ASSEMBLY.
 4. EXTERIOR HOSE BIBS SHALL HAVE A VACUUM BREAKER.
 5. ALL PIPE & FITTINGS FROM FLARED ANGLE VALVE THROUGH LAST BALL VALVE SHALL BE BRASS THREADED.

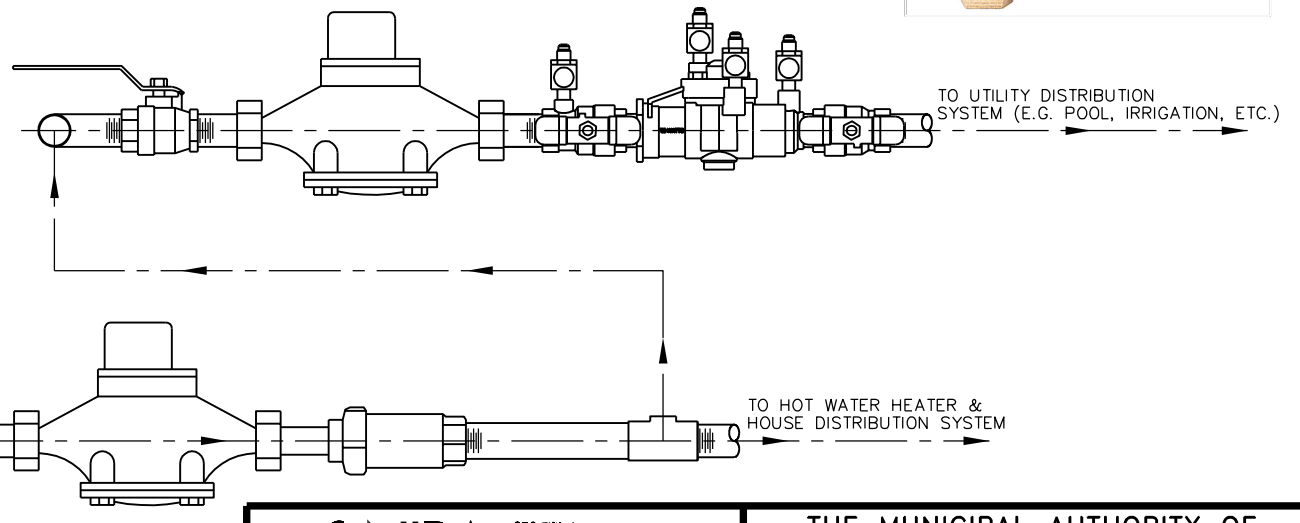

ELEVATION

<p>NIRA Consulting Engineers, Inc. 950 Fifth Avenue Coraopolis, PA 15108 www.niraengineers.com mail@niraengineers.com</p>		
		DR. BY: C.J.R.
SHT. NO. 1 OF 1		SCALE: N.T.S.

<p>THE MUNICIPAL AUTHORITY OF THE TOWNSHIP OF ROBINSON</p>
<p>TYPICAL RESIDENTIAL DUAL METER INSTALLATION</p>